




PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

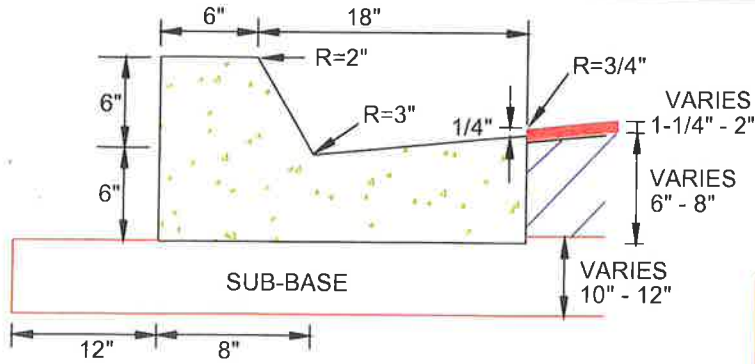


F.D.O.T. TYPE "F" CURB

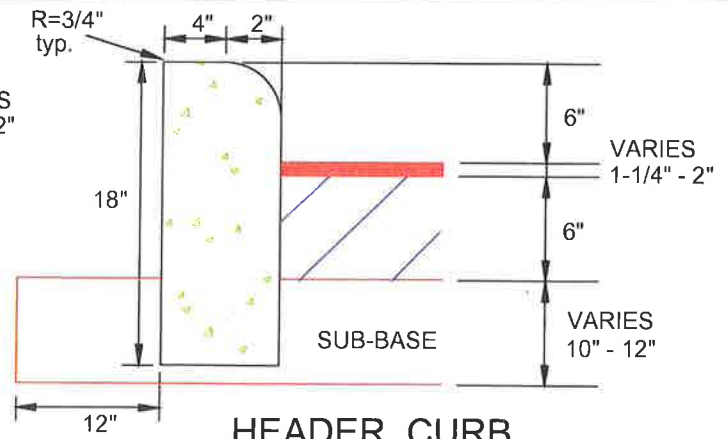


HEADER CURB

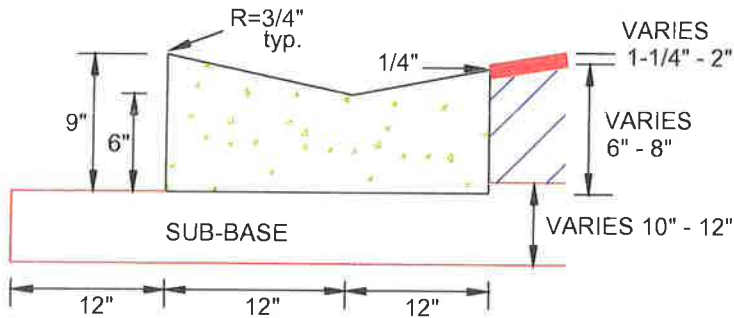


MIAMI CURB

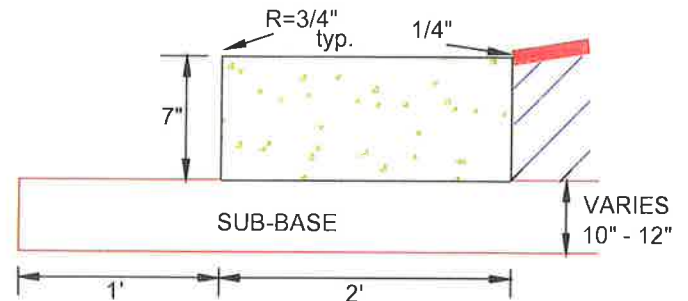

RIBBON CURB

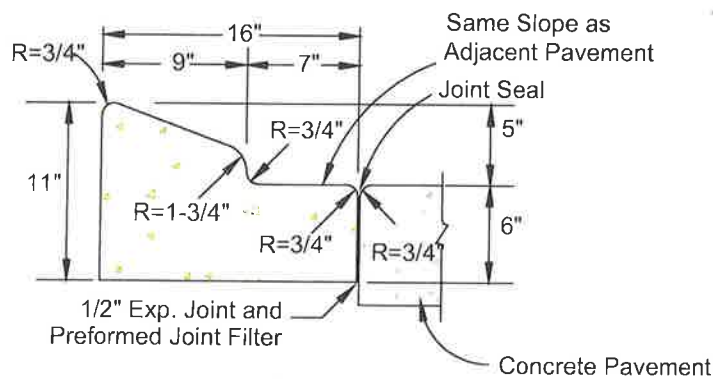

TYPE "A" CURB

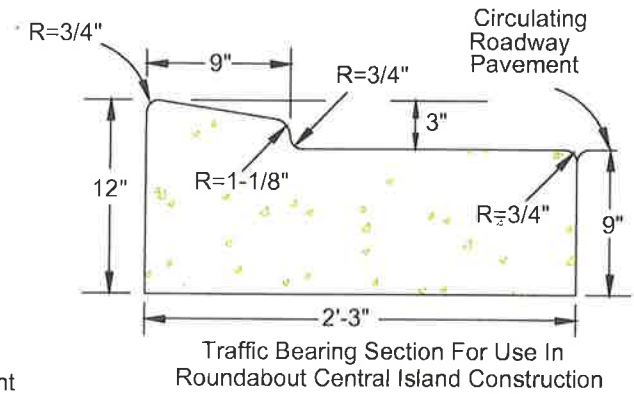

TYPE "RA" CURB

NOTES:

1. ALL CURBS TO BE CONSTRUCTED OF 28 DAY, 3,000 P.S.I. CONCRETE.
2. 1/2" PRE-MOLDED EXPANSION JOINT REQUIRED EVERY 500', CONSTRUCTION JOINT REQUIRED EVERY 10' MAXIMUM (4' MINIMUM).
3. 1/2" PRE-MOLDED EXPANSION JOINT REQUIRED AT EACH SIDE OF ALL STORM INLET STRUCTURES AND AT ALL RADIUS POINTS.
4. SUB-BASE TO BE COMPACTED AND TESTED TO 98% MINIMUM DENSITY WITH MINIMUM L.B.R. 40 BASED ON AASHTO T-180 MODIFIED PROCTOR TEST.
5. EXPANSION JOINT MATERIAL MUST COVER THE ENTIRE CROSS SECTION OF CURB.







CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

STANDARD CURB CONSTRUCTION

MI009-2

ISSUED 2017


REVISED 03/01/2017 BY DJB

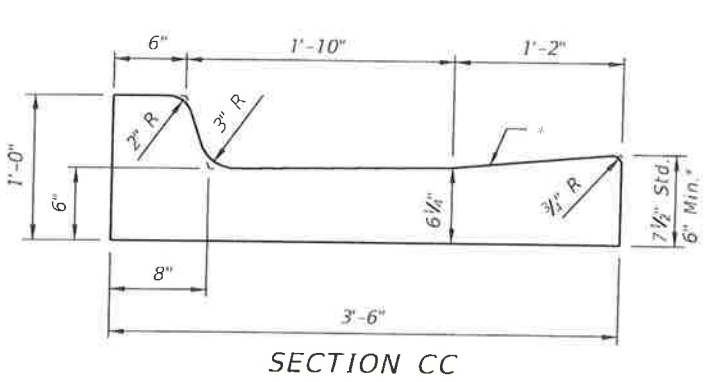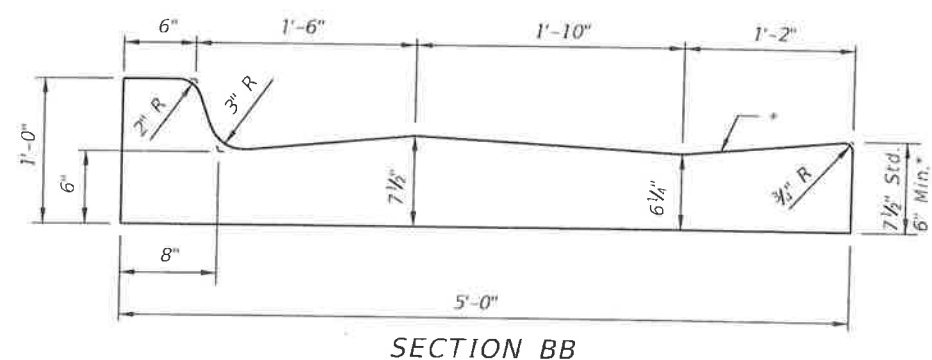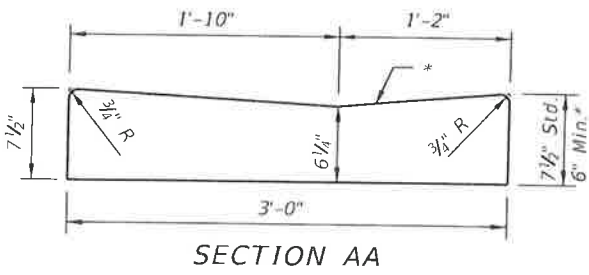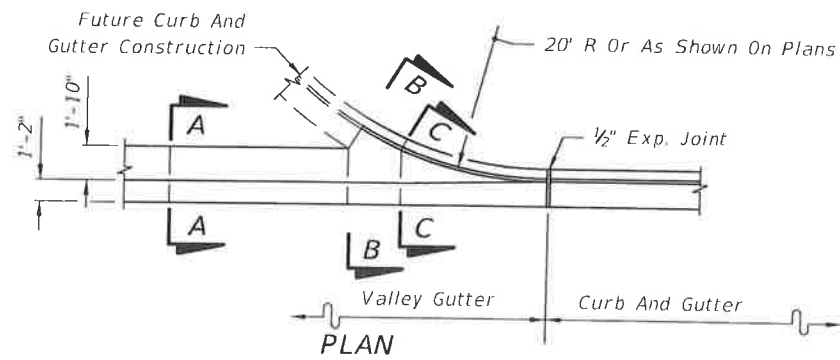


VALLEY GUTTER

- * When used on high side of roadways, the cross slope of the gutter shall match the cross slope of the adjacent pavement. The thickness of the lip shall be 6", unless otherwise shown on plans.
- █ Rotate entire section so that gutter cross slope matches slope of adjacent circulating roadway pavement.


For use adjacent to concrete or flexible pavement. For details depicting usage adjacent to flexible pavement, see Sheet 2. Expansion joint, preformed joint filler and joint seal are required between curb & gutter and concrete pavement only, see Sheet 2.

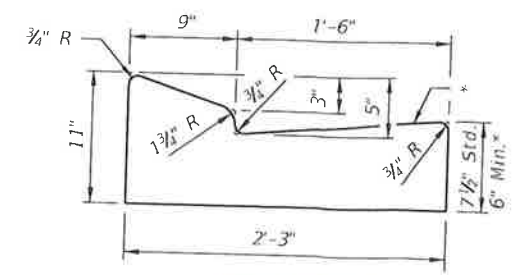

TYPE E

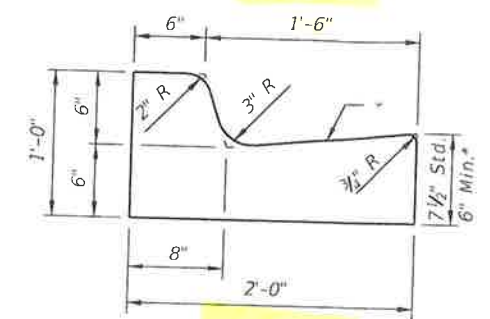


TYPE F

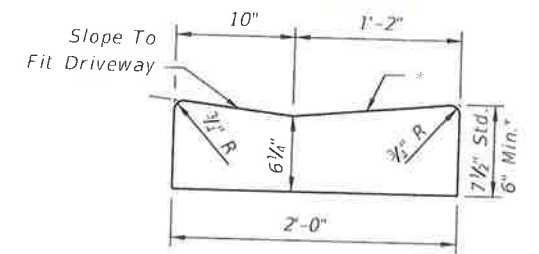


Note: To be paid for as parent curb.


DROP CURB

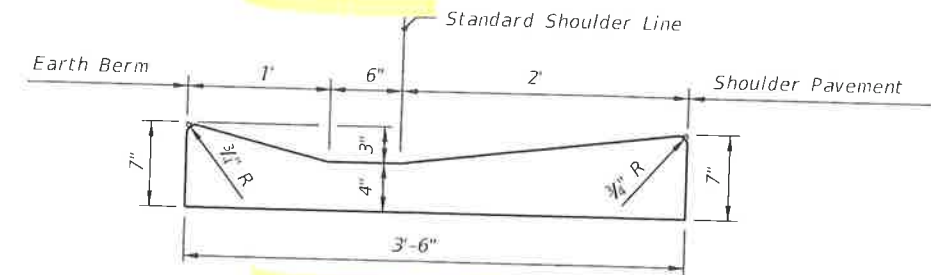


SHOULDER GUTTER

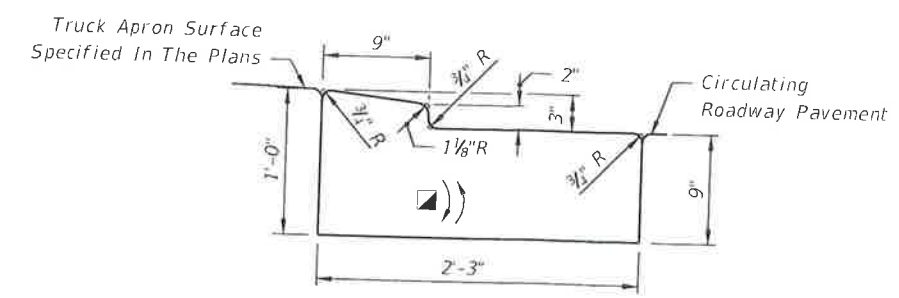


TRAFFIC BEARING SECTION FOR USE IN ROUNDABOUT CENTRAL ISLAND CONSTRUCTION
TYPE RA

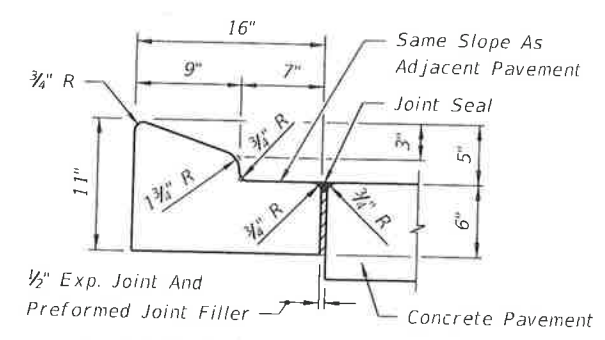

TYPE A

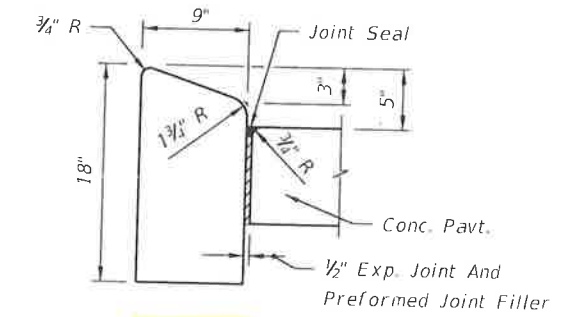

TYPE B

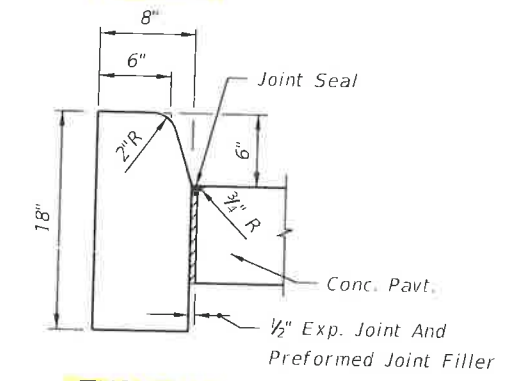


TYPE D

Note: For use adjacent to concrete or flexible pavement, concrete shown. Expansion joint, preformed joint filler and joint seal are required between curbs and concrete pavement only, see Sheet 2.

CONCRETE CURB

CONCRETE CURB AND GUTTER

C:\v\p\projects\standards\Roadway\00300-s\00300-01.dgn
r19960rh
9:37:51 AM
6/28/2012

LAST REVISION	DESCRIPTION:	 FDOT DESIGN STANDARDS 2013	CURB & CURB AND GUTTER	INDEX NO.	SHEET NO.
00				300	1